

MODEL	FORCE [N]	POWER SUPPLY	DESCRIPTION
MVE206R	600	230Vac±10%	long yoke, modulating/ floating control with position emergency return with totally open or closed valve selectable through jumper
MVE206SR	600	230Vac±10%	short yoke, modulating/ floating control with position emergency return with totally open or closed valve selectable through jumper



APPLICATION AND USE

MVER is a flexible electro-mechanical actuator equipped with electronic fail safe function device for the control of two-way and three-way globe valves in:

- Heating and cooling systems;
- Air Handling Units;
- District heating plants;
- Industrial temperature control systems.

The actuator is endowed with an electronic emergency return function which operates through the use of ultracapacitors whose life is about 10 years if the actuator operates within the operation limits declared in this data sheet.

The emergency position (retracted or extended stem) is set through the use of a jumper which can be easily reached (look at paragraph "DIP switches and jumper settings").

The actuator is supplied with totally discharged ultracapacitors and at its first start a pre-charge phase of about 130s will be necessary.

During this phase all the functions of the actuator are inhibited and the charge status of the ultracapacitors is signalled through 2 LEDs (look at paragraph "Standard LEDs").

MVER can be controlled either by a proportional (modulating) signal or by an increase/decrease (floating) signal.

It is easy to mount and connect the actuator. Direct mounting is possible to any CONTROLLI flanged valve. Linkage kits are available for CONTROLLI threaded valves as well as for valves of other manufacturers. The actuator has a fine resolution (500 steps on the full stroke range) for accurate fluid control and it is able to self-calibrate on a different stroke without the need of any user action (this function is DIP switch selectable on the field).

MVER has intelligent behavior and alarm functionality in case of unexpected operation, feedback of alarms to the user is provided by LEDs (GREEN and RED) on the upper control board.

N.B.: do not use the actuator if not coupled with its relating valve.

OPERATION

The actuator is endowed with an electronic fail safe function which, in case of power failure, allows to close (or to open) the valve and to go back to the set position through the jumper.

The actuator commutes the control signal (modulating or 3-point floating) from the controller into a valve position. A modern brushless DC motor in the actuator drives a gear train and a worm gear – screw jack mechanism convert the motor revolutions into accurate and repeatable linear movements.

Control Signal

MVER can be controlled by one of 2 main control types.

- 3-point floating ;
- Modulating (or proportional) signal with filed selectable range (e.g., 0-10Vdc, 2-10Vdc, 0-5/2-6Vdc, 5-10/6-10Vdc and 4-20mA).

Manual Override

There is a manual operation handle on the actuator. When it is lowered (manual override ON), the power supply to the motor power stage circuitry is cut and the motor stops. The actuator can be operated manually and the valve positioned accordingly.

The manual override lever stays in position until it is raised again, then board and motor will be powered again. At the end of this operation, the actuator moves to initial position (on the basis of DIP n. 1 setting), then it follows the control signal. When the manual override is engaged the GREEN and the RED LED on the lower electronic board are ON.

Manual operation handle can also be used to modify any DIP switch setting or as re-set function after any alarm occurrence.

The actuator is supplied with the manual override lowered (ON). It is not necessary to remove power supply to modify DIP switches setting.

Position Feedback

MVER utilizes a 2-10V position feedback (look at DIP n. 1 settings).

Calibration

MVER ha both Auto and Manual Stroke Calibration. Actuator is delivered with DIP n. 7 set to Auto. Manual calibration is not necessary unless maintenance is required on the valve or certain alarm functions are desired.

End Point Auxiliary Switches (with accessory DMVE)

End point switches change over when the valve is fully open or closed. They are free contacts with 24Vac max voltage on terminals. End point switches can be utilized to indicate valve stroke end positions and for relay control of additional plant equipment. When the actuators are controlled individually or in sequence, it is possible to use the end switches to toggle when the valve is fully open or fully closed. The auxiliary switch position according to control signal (Y) is shown in the picture below.


CONTROL SIGNAL (Y)	RELAY KC1	RELAY KC2
0-0,5V	KC1 to K2	KC2 to K3
0,5-9,5V	KC1 to K1	KC2 to K3
9,5-10V	KC1 to K1	KC2 to K4

Diagnostic

The actuator is provided with a self diagnostic algorithm able to detect faulty conditions:

- stroke out of range 5-60mm;
- unexpected stall condition (e.g., valve stuck);
- missing expected stall condition (e.g., link loose);
- voltage supply out of range.

These faulty conditions are signalled via the GREEN and RED LED on the lower electronic board blinking accordingly (see "Diagnostic – Alarm Function Table").

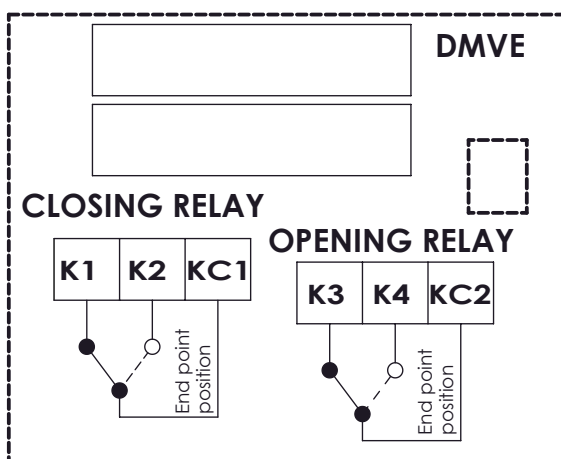


TECHNICAL FEATURES


MVE206R/SR	
Alimentazione F N	230Vac ±10%, 50-60Hz
Power consumption (running)	13VA/6W
Power consumption (Holding)	11VA/5W
Charging phase consumption	32VA/18W
Ultracapacitors charging phase (if totally discharged)	300s
Running and emergency return time	
Modulating 5-14,9mm	15s
Modulating 15-24,9mm	20s
Modulating 25-39,9mm	25s
Modulating 40-60mm	30s
Floating	60s
Transformer Size [VA]	50
Stroke	5-60mm
Force	600N
Duty cycle	max 50%/60 minutes
Analog input Y M	Voltage 0-10V - impedance > 100kΩ (range: 0-10 2-10 0-5/2-6 5-10/6-10) 500Ω (range 4-20mA)
Digital inputs Y1-Y2	Connection of Y1, Y2 to M
Output V+	Voltage 16Vdc ± 0,5V Max Load 25mA,
Output U	Voltage 2-10Vdc (0-100%) Max Load 2mA
Number of cycles of emergency	1.000
Type of movement	linear
Ambient temperature	Operation and storage -10/+50°C
Ambient Humidity	max 90% RH
Protection degree	IP54
Insulation class	III
Standard	Emission/Immunity EMC 2004/108/CE according to EN 61326-1:2006 standard
Material	Housing: Aluminum - Cover: ABS plastic
Color	Aluminum / White
Weight [kg]	1.5
Dimensions [mm]	Refer to the picture on page 7

ASSEMBLING

The actuator can be mounted with any orientation but never up-side down. When the fluid temperature exceeds 120°C the actuator shall be mounted leaning 45°.

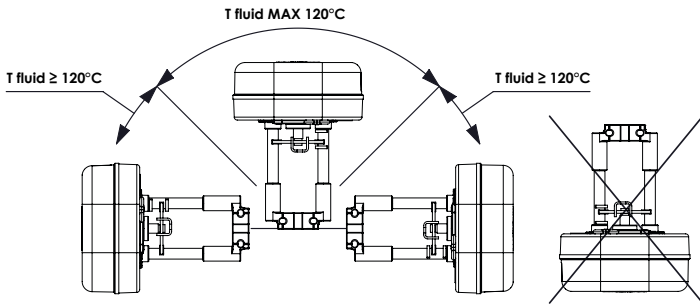

To mount the actuator on to a valve, position the valve stem to the bottom of its travel, slide the actuator onto the valve neck, adjusting with the manual override the screw jack position so the square nut on the valve spindle fits into the groove on the cross bar. Then slide the brace into the groove on the valve neck and secure the nuts.

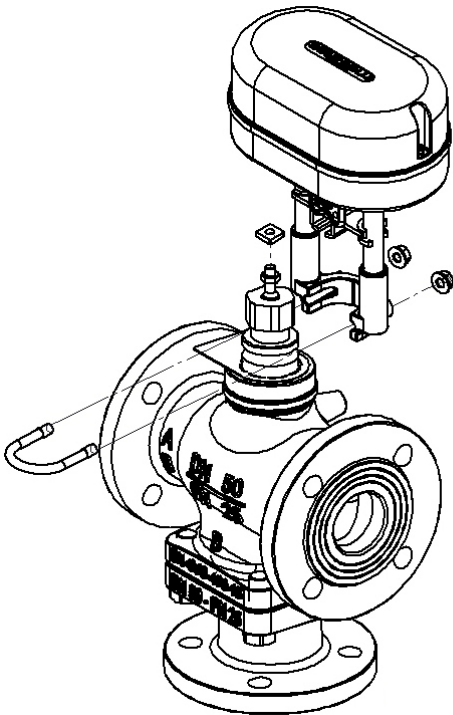

See mounting instructions for full details (MVE2xxR_DIM266).

MAINTENANCE

The actuator is maintenance free.


ACCESSORIES

DMVE Endpoint auxiliary switches
248 Yoke heater 24Vac, 50W (suggested when the fluid temperature is below 0°C)

LINKAGE	MVER	MVESR
Current Controlli valves (except for 2TGB.F/3TGB.F PN16)	(not required)	/
2TGB.F/3TGB.F PN16	/	(not required)
Controlli valves with threaded M40 connections (except for VSB/VMB/VSBF/VMBF PN16)	AG51	/
VSB/VMB/ VSBF/VMBF PN16	AG52	AG63
<u>Other manufacturers</u>		
Siemens *	AG70-10 AG70-14	/
Danfoss (VR/VF (S) models)	AG60-07	/
TAC DN15-V298	AG 60-08	/
TAC DN15-V2XX/V3XX	AG 60-09	/
Honeywell**	AG 60-10	/
Airtek	AG 60-11/ AG60-12	/
Johnson Controls VB7816-2111	AG 66	/
Johnson Controls BM-3018-3300	AG 67	/
MUT MK DN50-150	AG69	/
Tac Venta	(not required)	/
(/) this model can not be assembled		
(*) AG70-10 for valves having stem \varnothing 10mm AG70-14 for valves having stem \varnothing 14mm		
(**) valid for the followign models: M6: V176A. B, V538C 1/4": V5011A		


ELECTRIC CONNECTIONS

Remove the cover screw with a screwdriver and then remove the cover as shown in the picture below. The actuator is equipped with a 6 poles removable terminal block; each pole of the plug is clearly marked and the same label are reported on the electronic board. Before powering up the actuator make sure the plug is properly connected to the board and the label on the plugs and on the board match.

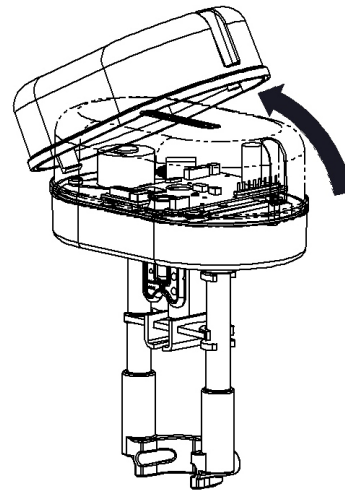

GROUND CONNECTIONS


Connect the ground terminal to the proper screw labelled with the ground symbol as shown in the picture here below.

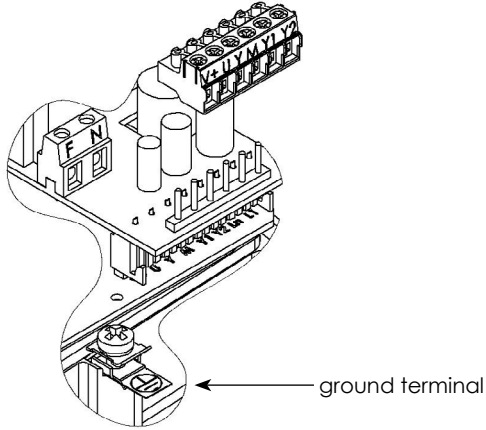

Use cable gland PG13,5 model (not supplied).


LABEL	DESCRIPTION	FUNCTION	MIN WIRE SIZE	MAX WIRE LENGTH
F	230Vac	Power Supply	1.5mm ²	75m
N				
Y	0..10Vdc	Modulating Control Input	0.5mm ²	200m
M	0V (Common)			
Y1	Open	Floating Control Input	0.5mm ²	200m
Y2	Close			
V+	16 Vdc	Voltage Output (max 25mA)	0.5mm ²	200m
M	0V (Common)			
U	2±10Vdc	Feedback Output Signal	0.5mm ²	200m
M	0V (Common)			

3p Floating Control

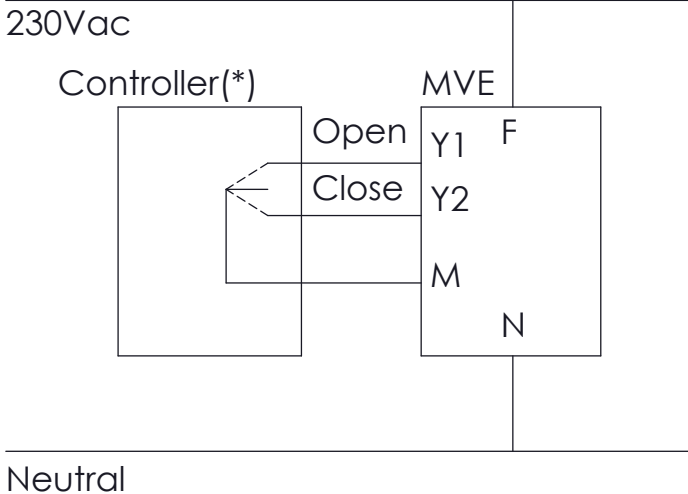

(*) MVE contain a half-wave rectifier power supply. They must not be powered with transformers that are used to power other devices using not isolated full-wave rectifier power supply.

Modulating Control (0-10Vcc)

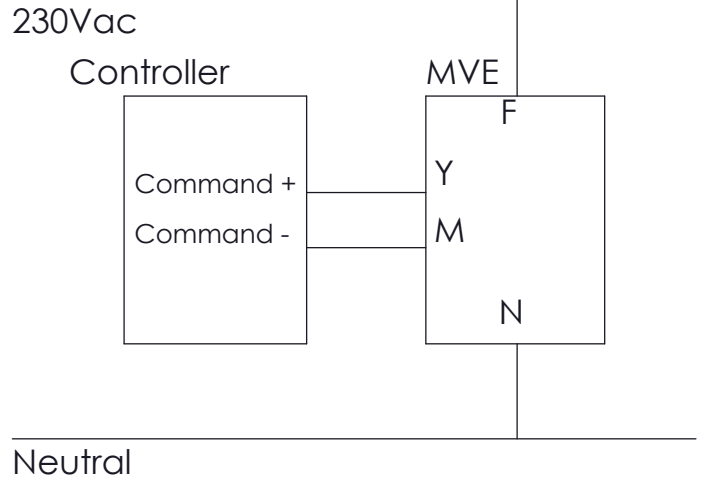


SAFETY PERSCRIPTIONS

230 V products

1. Install on the power supply line a protecting device to avoid short circuits (fuse or magneto-thermic) according to the specifications in force.
2. In case of accidental removal of the cover to make sure that power is disconnected before working on the actuator or near it.
3. The products are maintenance free.

TERMINAL BLOCK



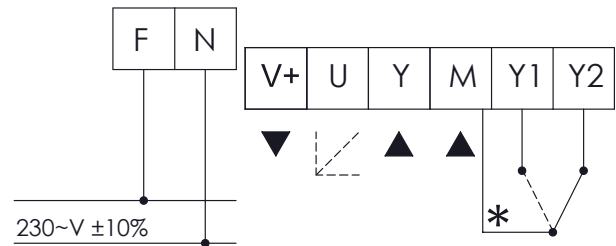


(*) In order to use the floating control the only possible connection is between terminal M and Y1/Y2. Do not connect Y1/Y2 to phase (F) or neutral (N).

DIP SWITCHES AND JUMPER SETTINGS

Set the DIP switches according to the tables here below. In order to be sure that any modification has been accepted by the actuator, power down and power it up again or act on the manual operation handle.

Factory settings

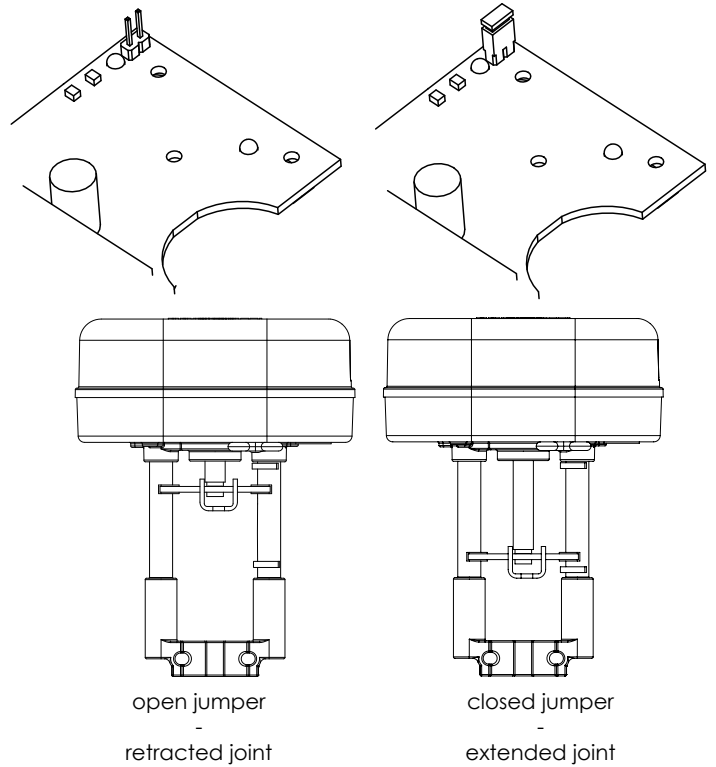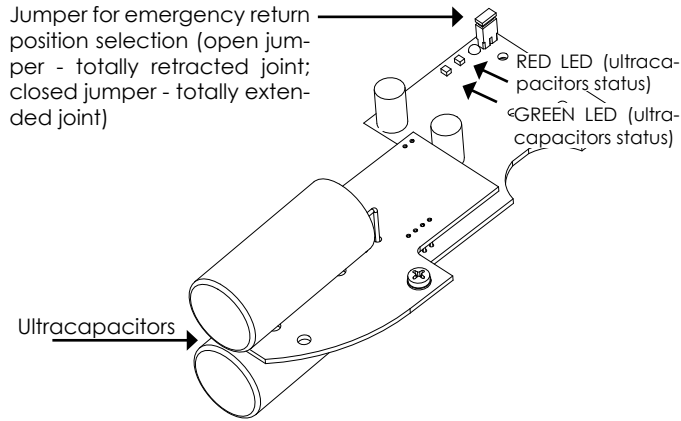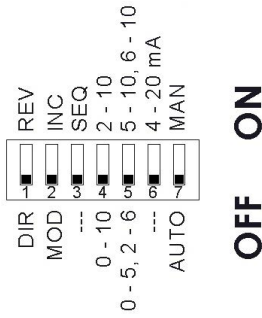

DIP SWITCH	OFF	ON
1	<p>U= feedback</p> <p>Direct Action</p> <p>U = 2V</p> <p>U = 10V</p>	<p>U= feedback</p> <p>Reverse Action</p> <p>U=10V</p> <p>U = 2V</p>
2	<p>Modulating Control (MOD) (Input between Y [+] and M [-])</p>	<p>3 point floating (INC) (Y1 open-extend , Y2 close-retract connected to M)</p>
3	-	Selection of sequence mode, control range defined by DIP n. 5
4	Modulating Control 0-10Vdc (DIP n. 2 OFF only)	Modulating Control 2-10Vdc (DIP n. 2 OFF only)
5	Sequence Control 0-5Vdc with DIP n. 4 OFF only Sequence Control 2-6Vdc with DIP n. 4 ON only (DIP n. 3 ON only)	Sequence Control 5-10Vdc with DIP n. 4 OFF only Sequence Control 6-10Vdc with DIP n. 4 ON only (DIP n. 3 ON only)
6	Voltage Input Signal Vdc (input between Y [+] and M [-])	Current Input Signal 4-20mA (input between Y [+] and M [-]). In this case DIP n. 4 must be ON.
7	Automatic Calibration: the actuator update the stroke range if an unexpected mechanical stop is detected for at least 10s	Manual Calibration: the actuator calibration is started moving the switch from OFF to ON; if the switch is left in ON the actuator will never update the calibrated stroke value even when an unexpected endpoint is detected

N°	LED	ERROR	WHEN	ACTUATOR BEHAVIOUR		TYPICAL TROUBLE SHOOTING CONDITION	RESET PROCEDURE
				Automatic Calibration SW7 OFF	Manual Calibration SW7 ON		
1	RED ON	Calibrated stroke valve less than 5 mm	Calibration / first installation	The actuator push/pull 5 times (unexpected stall) trying to remove the possible obstacle. After 5 try alarm is signaled (RED Led ON) and the actuator moves to initial position and does not respond to control signal. Stroke value is not updated because out of range	The actuator push/pull 2 times against endpoint during calibration. Alarm is signaled (RED led On) and the actuator moves to the initial position and then it does not respond to the control signal.	Valve with a stroke length lower than 5 mm	Remove power and repeat calibration
2	RED ON	Stroke longer than 60 mm	Calibration / first installation	The actuator exits the 60 mm stroke range and it moves toward the new stroke limit signaling an anomaly (RED led on). The actuator does not calibrate the stroke	The actuator push/pull 2 times against endpoint during calibration. Alarm is signaled (RED led On) and the actuator moves to the initial position and then it does not respond to the control signal.	Valve with a stroke length longer than 60 mm	Remove power and repeat calibration
3	RED Quick Blinking + GREEN ON	Unexpected stall within the calibrated stroke range	normal operation	The actuator tries 5 times against the new stall condition and then after 10 second the actuator update the new stroke length	The actuator tries 5 times against the new stall condition and then after 10 second the actuator does not update the new stroke length	Valve stuck	Inverted control signal
4	RED Quick Blinking + GREEN ON	Stroke longer than expected	normal operation	The actuator moves toward the new stall condition with a lower speed; after 10 second the actuator update the new stroke value	The actuator moves toward the new stall condition with a lower speed; after 10 second the actuator does not update the new stroke value	stem connection loose or valve damaged	Inverted control signal
5	RED slow Blinking	Low Power Voltage	normal operation	The actuator still working but performance cannot be guaranteed	The actuator still working but performance cannot be guaranteed	1. Wrong transformer size	Correct Voltage Power
						2. unstable power	
6	RED slow Blinking	High Power Voltage	normal operation	The actuator still working but performance cannot be guaranteed	The actuator still working but performance cannot be guaranteed	1. Wrong transformer size	Correct Voltage Power
						2. unstable power	


STANDARD LEDs

Lower electronic board


N°	LED	ACTUATOR STATUS
1	GREEN ON	The actuator arrived at the extreme point of the stroke
2	GREEN BLINKING	The actuator is moving or arrived at the intermediate point of the stroke
3	RED GREEN BLINKING ALTERNATING	Calibration or initialization phase
4	RED GREEN ON	Manual control ON, the actuators ignores the control signal. ATTENTION! The electronic board is electrically supplied
5	RED GREEN BLINKING SIMULTANEOUS	The actuator is in emergency return phase

Upper electronic board

LED	ULTRACAPACITORS STATUS
GREEN	ultracapacitors charged
RED	ultracapacitors discharging
OFF	ultracapacitors totally discharged

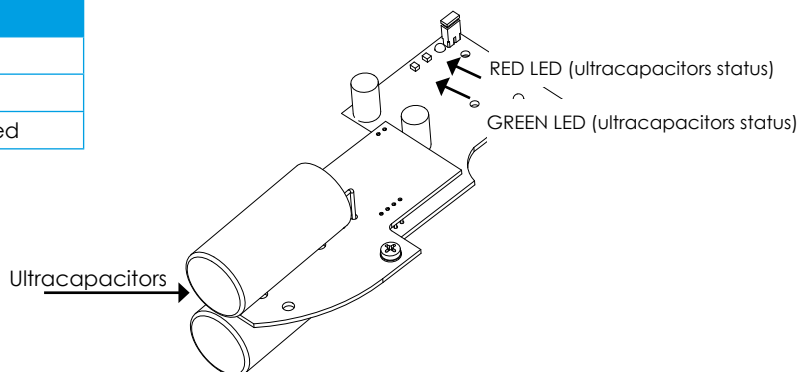

DIMENSIONS [mm]

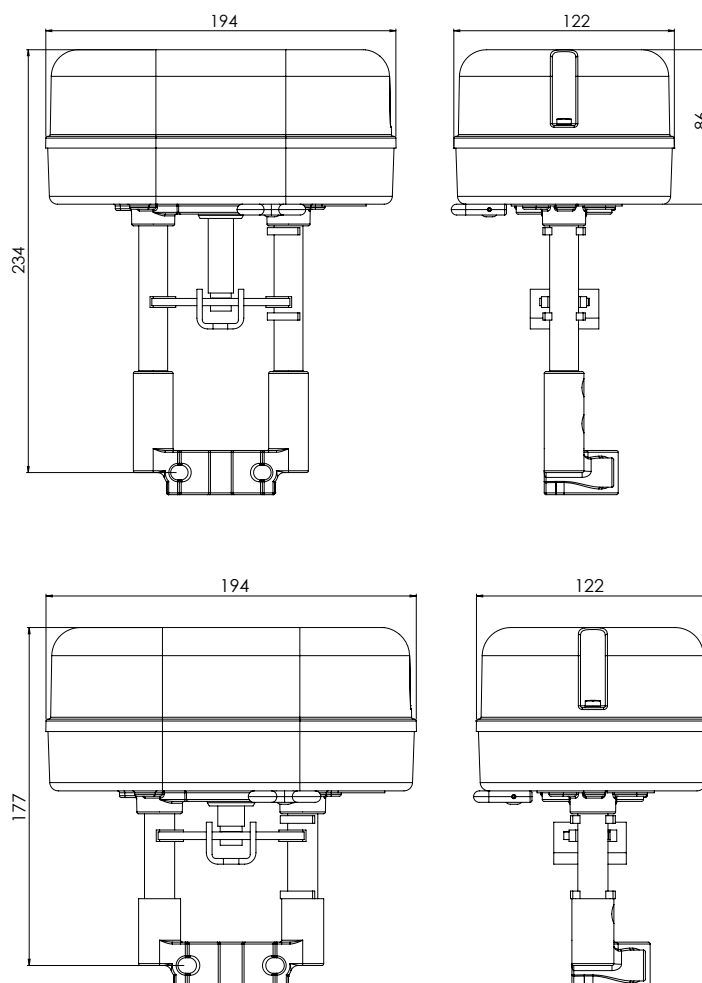

The performances stated in this sheet can be modified without any prior notice